



中国国家强制性产品认证证书

证书编号: 2013010307657942

委托人名称、地址

ABB Stotz Kontakt GmbH
Eppelheimer Strasse 82, 69123 Heidelberg, Germany

生产者(制造商)名称、地址

ABB Stotz Kontakt GmbH
Eppelheimer Strasse 82, 69123 Heidelberg, Germany

生产企业名称、地址

北京ABB低压电器有限公司
北京市北京经济技术开发区康定街17号

产品名称和系列、规格、型号

塑料外壳式断路器
S20...M...UC, S20...M...DC; 详见参数附件

产品标准和技术要求

GB 14048.2-2008

上述产品符合强制性产品认证实施规则
CNCA-01C-011: 2007的要求, 特发此证。

发证日期: 2013年11月22日

有效期至: 2018年11月22日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询



主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>



Q 0830778



中国国家强制性产品认证证书

附录:

第 1 页 共 4 页

证书编号: 2013010307657942

纸号: 0830778

S20...M...UC, S20...M...DC; 型号解释详见附录;

Ui: 278V(1P), 500V(2P, 3P, 4P);

Ue: AC133V/AC253V/DC110V/DC220V(1P),

AC230V/AC440V/DC220V/DC440V(2P, 3P, 4P);

In: B 特性: 1A, 2A, 3A, 4A, 6A, 8A, 10A, 13A, 16A, 20A, 25A, 32A,
40A, 50A, 63A;

C 特性: 0.5A, 1A, 1.6A, 2A, 3A, 4A, 6A, 8A, 10A, 13A, 16A, 20A,
25A, 32A, 40A, 50A, 63A;

S20...M...UC:

B 特性:

1P:

AC133V: 6A-63A: Ics=7.5kA, Icu=15kA; DC110V: Ics=10kA, Icu=20kA;

AC253V: 6A-40A: Ics=7.5kA, Icu=10kA; 50A-63A: Ics=Icu=6kA;

DC220V: 6A-63A: Ics=Icu=10kA;

2P, 3P, 4P:

AC230V: 6A-63A: Ics=18.75kA, Icu=25kA; DC220V: Ics=20kA, Icu=25kA;

AC440V: 6A-40A: Ics=7.5kA, Icu=10kA; 50A-63A: Ics=Icu=6kA;

DC440V: 6A-63A: Ics=Icu=10kA;

C 特性:

1P:

AC133V: 0.5A-63A: Ics=7.5kA, Icu=15kA; DC110V: Ics=10kA, Icu=20kA;

AC253V: 0.5A-40A: Ics=7.5kA, Icu=10kA; 50A-63A: Ics=Icu=6kA;

DC220V: 0.5A-63A: Ics=Icu=10kA;

注: 此附录与证书同时使用时有效。



主 任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 2 页 共 4 页

证书编号: 2013010307657942

纸号: 0830778

2P, 3P, 4P:

AC230V: 0.5A-63A: $I_{cs}=18.75kA$, $I_{cu}=25kA$; DC220V: $I_{cs}=20kA$, $I_{cu}=25kA$;

AC440V: 0.5A-40A: $I_{cs}=7.5kA$, $I_{cu}=10kA$; 50A-63A: $I_{cs}=I_{cu}=6kA$;

DC440V: 0.5A-63A: $I_{cs}=I_{cu}=10kA$;

S20...M...DC:

B 特性:

1P:

DC110V: 1A-63A: $I_{cs}=10kA$, $I_{cu}=20kA$; DC220V: $I_{cs}=I_{cu}=10kA$;

2P, 3P, 4P:

DC220V: 1A-63A: $I_{cs}=20kA$, $I_{cu}=25kA$; DC440V: $I_{cs}=I_{cu}=10kA$;

C 特性:

1P:

DC110V: 0.5A-63A: $I_{cs}=10kA$, $I_{cu}=20kA$; DC220V: $I_{cs}=I_{cu}=10kA$;

2P, 3P, 4P:

DC220V: 0.5A-63A: $I_{cs}=20kA$, $I_{cu}=25kA$; DC440V: $I_{cs}=I_{cu}=10kA$;

过电流脱扣器类型: 热磁式;

使用类别: A;

极数: 1P, 2P, 3P, 4P(直流产品接线方式示意图如下)

S20...UC/ S20.M DC 2P 产品在直流系统中应用的接线示意图

注: 此附录与证书同时使用时有效。



主 任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>






中国国家强制性产品认证证书

附录:


第 3 页 共 4 页

证书编号: 2013010307657942

纸号: 0830778

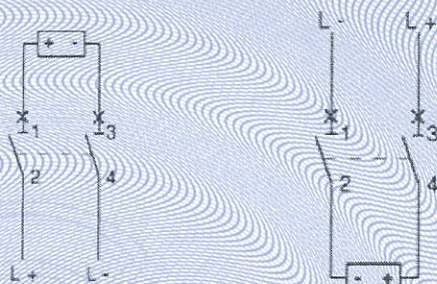


S20.M UC/ S20.M DC 3P 产品在直流系统中应用的接线示意图




3P---440V DC


S20.M UC/ S20.M DC 4P 产品在直流系统中应用的接线示意图

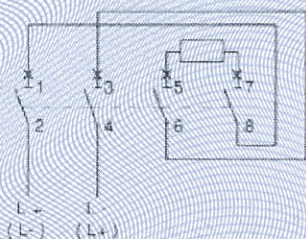

4P---440V DC

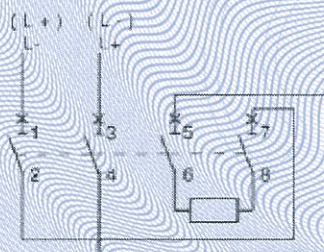

4P---440V DC



4P---440V DC

注: 此附录与证书同时使用时有效。



主任:

王志刚

中国质量认证中心

中国·北京·南四环西路188号9区 100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 4 页 共 4 页

证书编号: 2013010307657942

纸号: 0830778

型号的解释:

$\frac{S20}{1}$ $\frac{2}{2}$ $\frac{M}{1}$ $\frac{B}{3}$ $\frac{16A}{4}$ $\frac{UC}{5}$

1——产品系列

2——保护极数, 1-1pole, 2-2pole, 3-pole, 4-4pole

3——脱扣特性, B-B 特性; C-C 特性

4——额定电流, B: 1A, 2A, 3A, 4A, 6A, 8A, 10A, 13A, 16A, 20A, 25A, 32A, 40A, 50A, 63A;

C: 0.5A, 1A, 1.6A, 2A, 3A, 4A, 6A, 8A, 10A, 13A, 16A, 20A, 25A, 32A, 40A, 50A, 63A

5——UC: 交流和直流通用, DC: 适用于直流

注: 此附录与证书同时使用时有效。



主 任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

No. : 2013010307657942

NAME AND ADDRESS OF THE APPLICANT

ABB Stotz Kontakt GmbH
Eppelheimer Strasse 82, 69123 Heidelberg, Germany

NAME AND ADDRESS OF THE MANUFACTURER

ABB Stotz Kontakt GmbH
Eppelheimer Strasse 82, 69123 Heidelberg, Germany

NAME AND ADDRESS OF THE FACTORY

ABB LV Installation Materials Co. Ltd., Beijing
No.17, Kangding Street, Beijing Economic-Technological Development Area,
100176, P.R.China

NAME, MODEL AND SPECIFICATION

Moulded Case Circuit-breaker
S20...M...UC, S20...M...DC; See the Appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB 14048.2-2008

This is to certify that the above mentioned products have met the requirements of implementation rules for compulsory certification (REF NO. CNCA-01C-011:2007).

Date of issue: Nov.22,2013 Date of expiry: Nov.22,2018

Validity of this certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.

This certificate can be verified through CNCA's website: www.cnca.gov.cn



President:

Wang Kejiao

CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China

<http://www.cqc.com.cn>



Q 0830778