Commissioning Instructions CI/LMT100/200-EN Rev. A

# **LMT Series**

# Magnetostrictive level transmitter LMT100 & 200 models

## Quick Start Guide

# K-TEK Level products

# Measurement made easy

#### Introduction

The LMT Series of level transmitters is a modular range of field mounted, microprocessor-based electronic transmitters, utilizing multiple sensor technologies. Accurate and reliable measurement of liquid levels is provided in even the most difficult and hazardous industrial environments. The LMT Series can be configured to provide specific industrial output signals, according to 4-20 mA with HART digital communication. The LMT Series consists of two models: LMT100 (insertion-mounted) and LMT200 (mounted on gauge (KM26).

### Standard Precautions

#### CAUTION

Only qualified and authorized personnel are to be tasked with the installation, electrical connection, commissioning and maintenance of the transmitter. Qualified personnel are those individuals who have experience in the installation, electrical connection, commissioning and operation of the transmitter or similar devices and hold the necessary qualifications. These qualifications include but not limited to:

- Training or instruction authorization to operate and maintain devices or systems according to safety engineering standards for electrical circuits, high pressures and aggressive media
- Training or instruction in accordance with safety engineering standards regarding maintenance and use of adequate safety systems.

Since the transmitter may form a link within a safety chain, it is recommended that the device be replaced immediately if defects are detected. In the event of use in a hazardous area, only non-sparking tools are to be used.

#### **IMPORTANT NOTE**

Read the LMT Series operating instructions carefully before working with the product. For personal and system safety and for optimum performance, make sure you thoroughly understand the contents before installing, using or maintaining this instrument.



## **Features**


- High accuracy: 0.01% of full scale or + 1.27mm
- Never requires re-calibration: set it & forget it
- Superior Sensor (Patent #5,473,245)
- Local indication with HMI display
- Dual compartment housing with separate field terminal compartment
- Loop powered to 22m (75ft) probe length
- Total and/or interface level measurement
- Pressure to 165.48 bar (2400 psig) Std. 124.1 bar (1800 psig)
- Temperature range: -195.5 to 426.6°C (-320 to 800°F) with options
- Field replaceable/upgradable electronics module
- Built-in RFI / EMI filter
- Field Replaceable / Upgradable Electronics Module
- Digital Communications
- Online Self-verification




# **LMT** Series

# Magnetostrictive level transmitter LMT100 & 200 models

## **Electrical Connections**

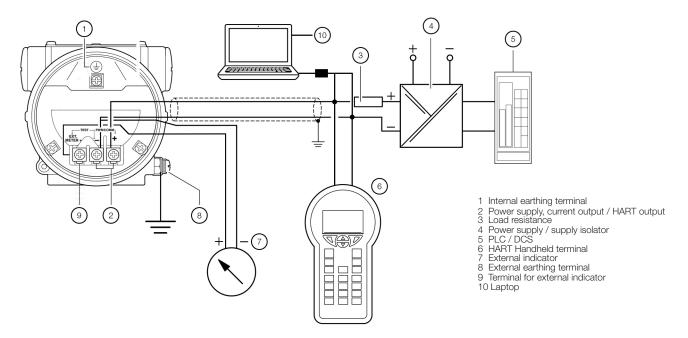

# Mounting

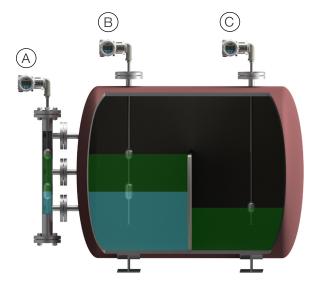

#### LMT100 Transmitters installations:

- A. Installed in external chambers in a level and interface measurement application
- B. Installed directly into vessel, measuring level and interface level
- C. Installed directly into vessel measuring level only

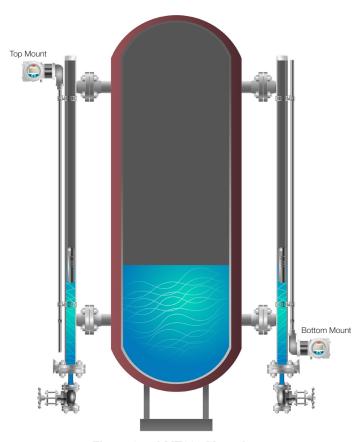


Figure 2 — LMT200 Mounting

#### Figure 1 — LMT100 Mounting

# **LMT Series**

# Magnetostrictive level transmitter LMT100 & 200 models

# Easy Setup

1. Log on to the LMT at the Standard or Advanced access level.



2. Select Easy Setup in the main menu



3. Select a language in the "Easy Setup" menu and press



4. Select available option of primary variable in the "Easy Setup" menu and press



5. Select available option of units of measure in the "Easy Setup" menu and press



6. Set LRV in the "Easy Setup" menu and press

LRV is the lower range value which corresponds to 4 mA current out value



7. Set URV in the "Easy Setup" menu and press

URV is the upper range value which corresponds to the 20 mA current out value



8. Set Damping time in the "Easy Setup" menu and press Damping allows smoothing step response in the device output.



9. Select displayed variable in the "Easy Setup" menu and press

Sets the selected process variable on the first line on the process display



10. Set a tag in the "Easy Setup" menu and press 

A tag is a quick way to identify the device



\*For detailed commission/operation steps refer to LMT operating instructions.

# LMT Series Magnetostrictive level transmitter LMT100 & 200 models

Specifications (Refer to LMT100/200 Datasheets for Details)			
Electronic transmitter:			
Repeatability	± 0.005% of Full Scale or 0.305 mm (0.012 in), whichever is greater		
Non-linearity	± 0.01% of Full Scale or 0.864 mm (0.034in), whichever is greater		
Measuring accuracy	± 0.01% of Full Scale or 1.27 mm (0.050 in), whichever is greater		
Supply voltage	12 to 42 Vdc - 4-20mA HART loop powered		
Output/Communications	4-20mA HART7®		
User Interface	Interactive display, DTM, EDDL with NE107 messaging		
Power consumption	4-20mA	at 36.0 Vdc - 3.6mA 0.13 watts; 21mA 0.76 watts	
		at 12.0 Vdc - 3.6mA 0.043 watts; 21mA 0.25 watts	
	HART mode (4.0mA)	at 36.0 Vdc 0.144 watts	
		at 12.0 Vdc 0.048 watts	
Ambient temperature	-40 to 85°C (-40 to 185°F) Ambient		
Humidity	0 to 100% RH		
Electrical connection	Two M20 x 1.5 or two 1/2in. FNPT, adapters and bus connectors also available		
Ingress protection	IP66, NEMA 4X		

Sensor tube:		
Material	316/L Stainless Steel	
Process temperature	LMT100: -195.5 to 121.1°C (-320 to 250°F)	
Process pressure	LMT100: -1.0 to 124.1 bar @ 149°C (-14.7 to 1800 psig @ 300°F)	
Probe length	LMT100: 304.8mm to 9.14m (1 to 30ft) / LMT200: 304.8mm to 15.24m (1 to 50ft)	

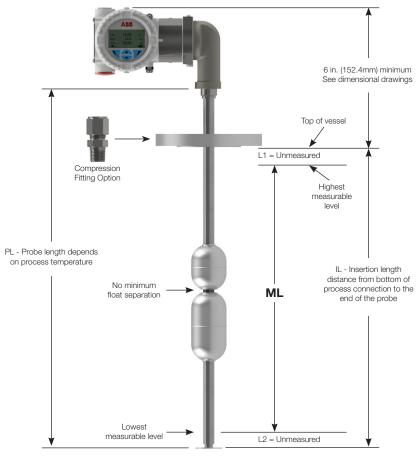


Figure 3 — LMT General Model

LMT Series Magnetostrictive level transmitter LMT100 & 200 models

#### ABB Inc.

17100 Manchac Park Lane (Suite B) Baton Rouge, LA 70817 USA Phone: +1 225 408 0800

Service: +1 225 408 0898 Fax: +1 225 408 0899

Service e-mail: ktek-service@us.abb.com

#### ABB Engineering (Shanghai) Ltd.

No. 5, Lane 369, Chuangye Road Kangqiao Town, Pudong District Shanghai, 201319, P.R. China Phone: +86 10 64231407

Service: +86 21 61056421 Fax: +86 10 64371913 E-mail: shan.li@cn.abb.com

Service e-mail: rola.li@cn.abb.com

www.abb.com/level

#### Note

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents - in whole or in parts - is forbidden without prior written consent of ABB.

Copyright© 2016 ABB All rights reserved

3KXL141100R4401







Service